


MONTAGE MOUNTING	
P	Montage sur panneau / Panel mounted
TENSION AUXILIAIRE AUXILIARY SUPPLY	
L	AUX.1 18...72 V =
H	AUX.2 80...265 V ≈
PRECISION DE MESURE PUISSANCE ET ENERGIE ENERGY AND POWER MEASUREMENTS ACCURACY	
8	CLASSE NON APPLICABLE CLASS NOT APPLICABLE
ENTREES LOGIQUES - CARTE G DIGITALS INPUTS - G CARD	
A	24V
B	3 Ent. logiques / Digital Inputs
C	110V
D	220V
E	2 Ent. logiques / Digital Inputs
F	24V
[74TC]	Choix obligatoire / Mandatory choice
110V	
220V	
CARTES OPTIONS (Nota 2) OPTION CARDS (Note 2)	
B	8 Ent. Logiques/Digital Inputs
C	5 Sort. Relais/Output Relays (2max.)
F	8x RTD Input (2max.)
J	2x LC 100Mb Eth (Optic fiber)
L	Serial Fiber (PP)
M	Serial Fiber (PG)
N	Serial Fiber (GP)
O	Serial Fiber (GG)

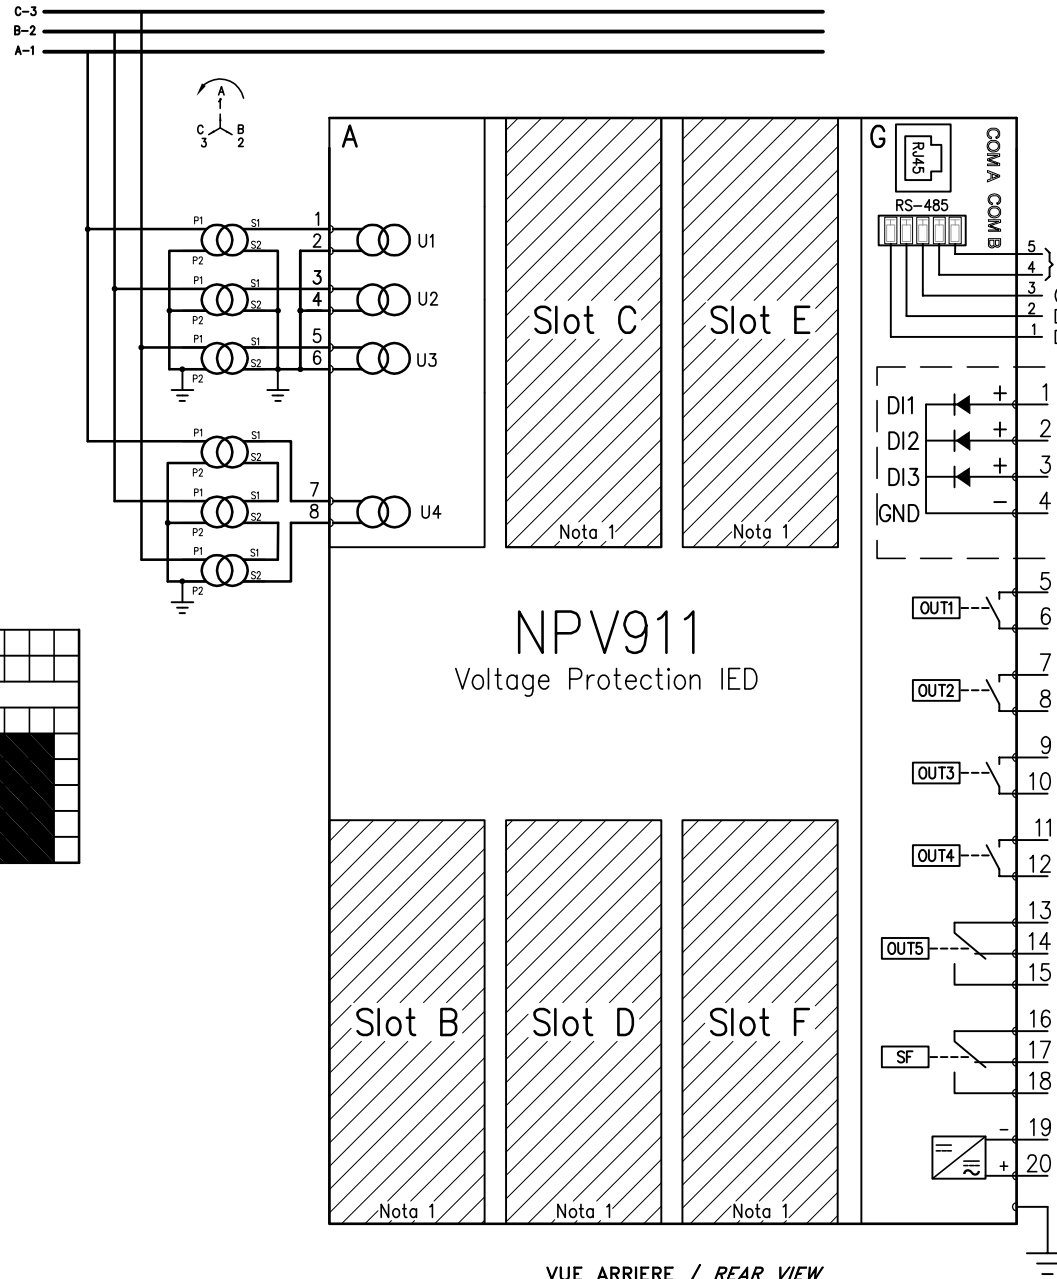

Nota 1: Cartes options cf. S42506 / Option Cards cf. S42506
 Nota 2: Un seul choix par colonne / One choice per column


NP900

**PROTECTION NUMERIQUE
NUMERICAL PROTECTION**

ANSI

[59]-[27]-[59P/27P/47]
 [59N]-[810/U]-[81R]-[78]
 [60]-[74TC]-[25]

BORNIER / TERMINALS
 (vue arrière) / (rear view)

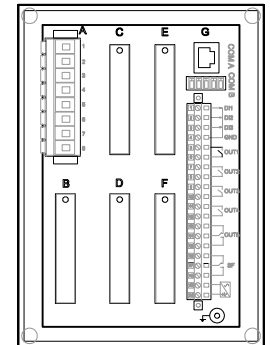

NPV911

B	Le 26.01.17 SSo	DESSINE SSO	VERIFIE EFR	N° CAO 5144
A	Diffusion Le 23.01.17 SSo	SCHEMA DE RACCORDEMENT CONNECTION DRAWING		1/1
S 42465				1/1

D	Le 01.08.17 VDL
C	Le 29.03.17 VDL

